


**GENERAL NOTES**


- A. ALL LOW VOLTAGE CONDUITS TO BE ROUTED TO NEAREST ACCESSIBLE CEILING SPACE / CABLE TRAY. USE MOST DIRECT ROUTE POSSIBLE. PROVIDE FIRESTOPPING AS REQUIRED FOR ALL PENETRATIONS.
- B. ALL LOW VOLTAGE CONDUITS TO BE SUPPLIED WITH NYLON BUSHING AND PULL STRING.
- C. PROVIDE CLEAR PERMANENT MARKING WITHIN UNFINISHED PORTION OF FLOOR BOX TO IDENTIFY WHETHER GANG IS RESERVED FOR AV, IT OR POWER.

**1 WIREMOLD EFB6S-OG FLOOR BOX COORDINATION DIAGRAM (FB1, FB3)**  
NTS

**2 NOT USED**  
NTS

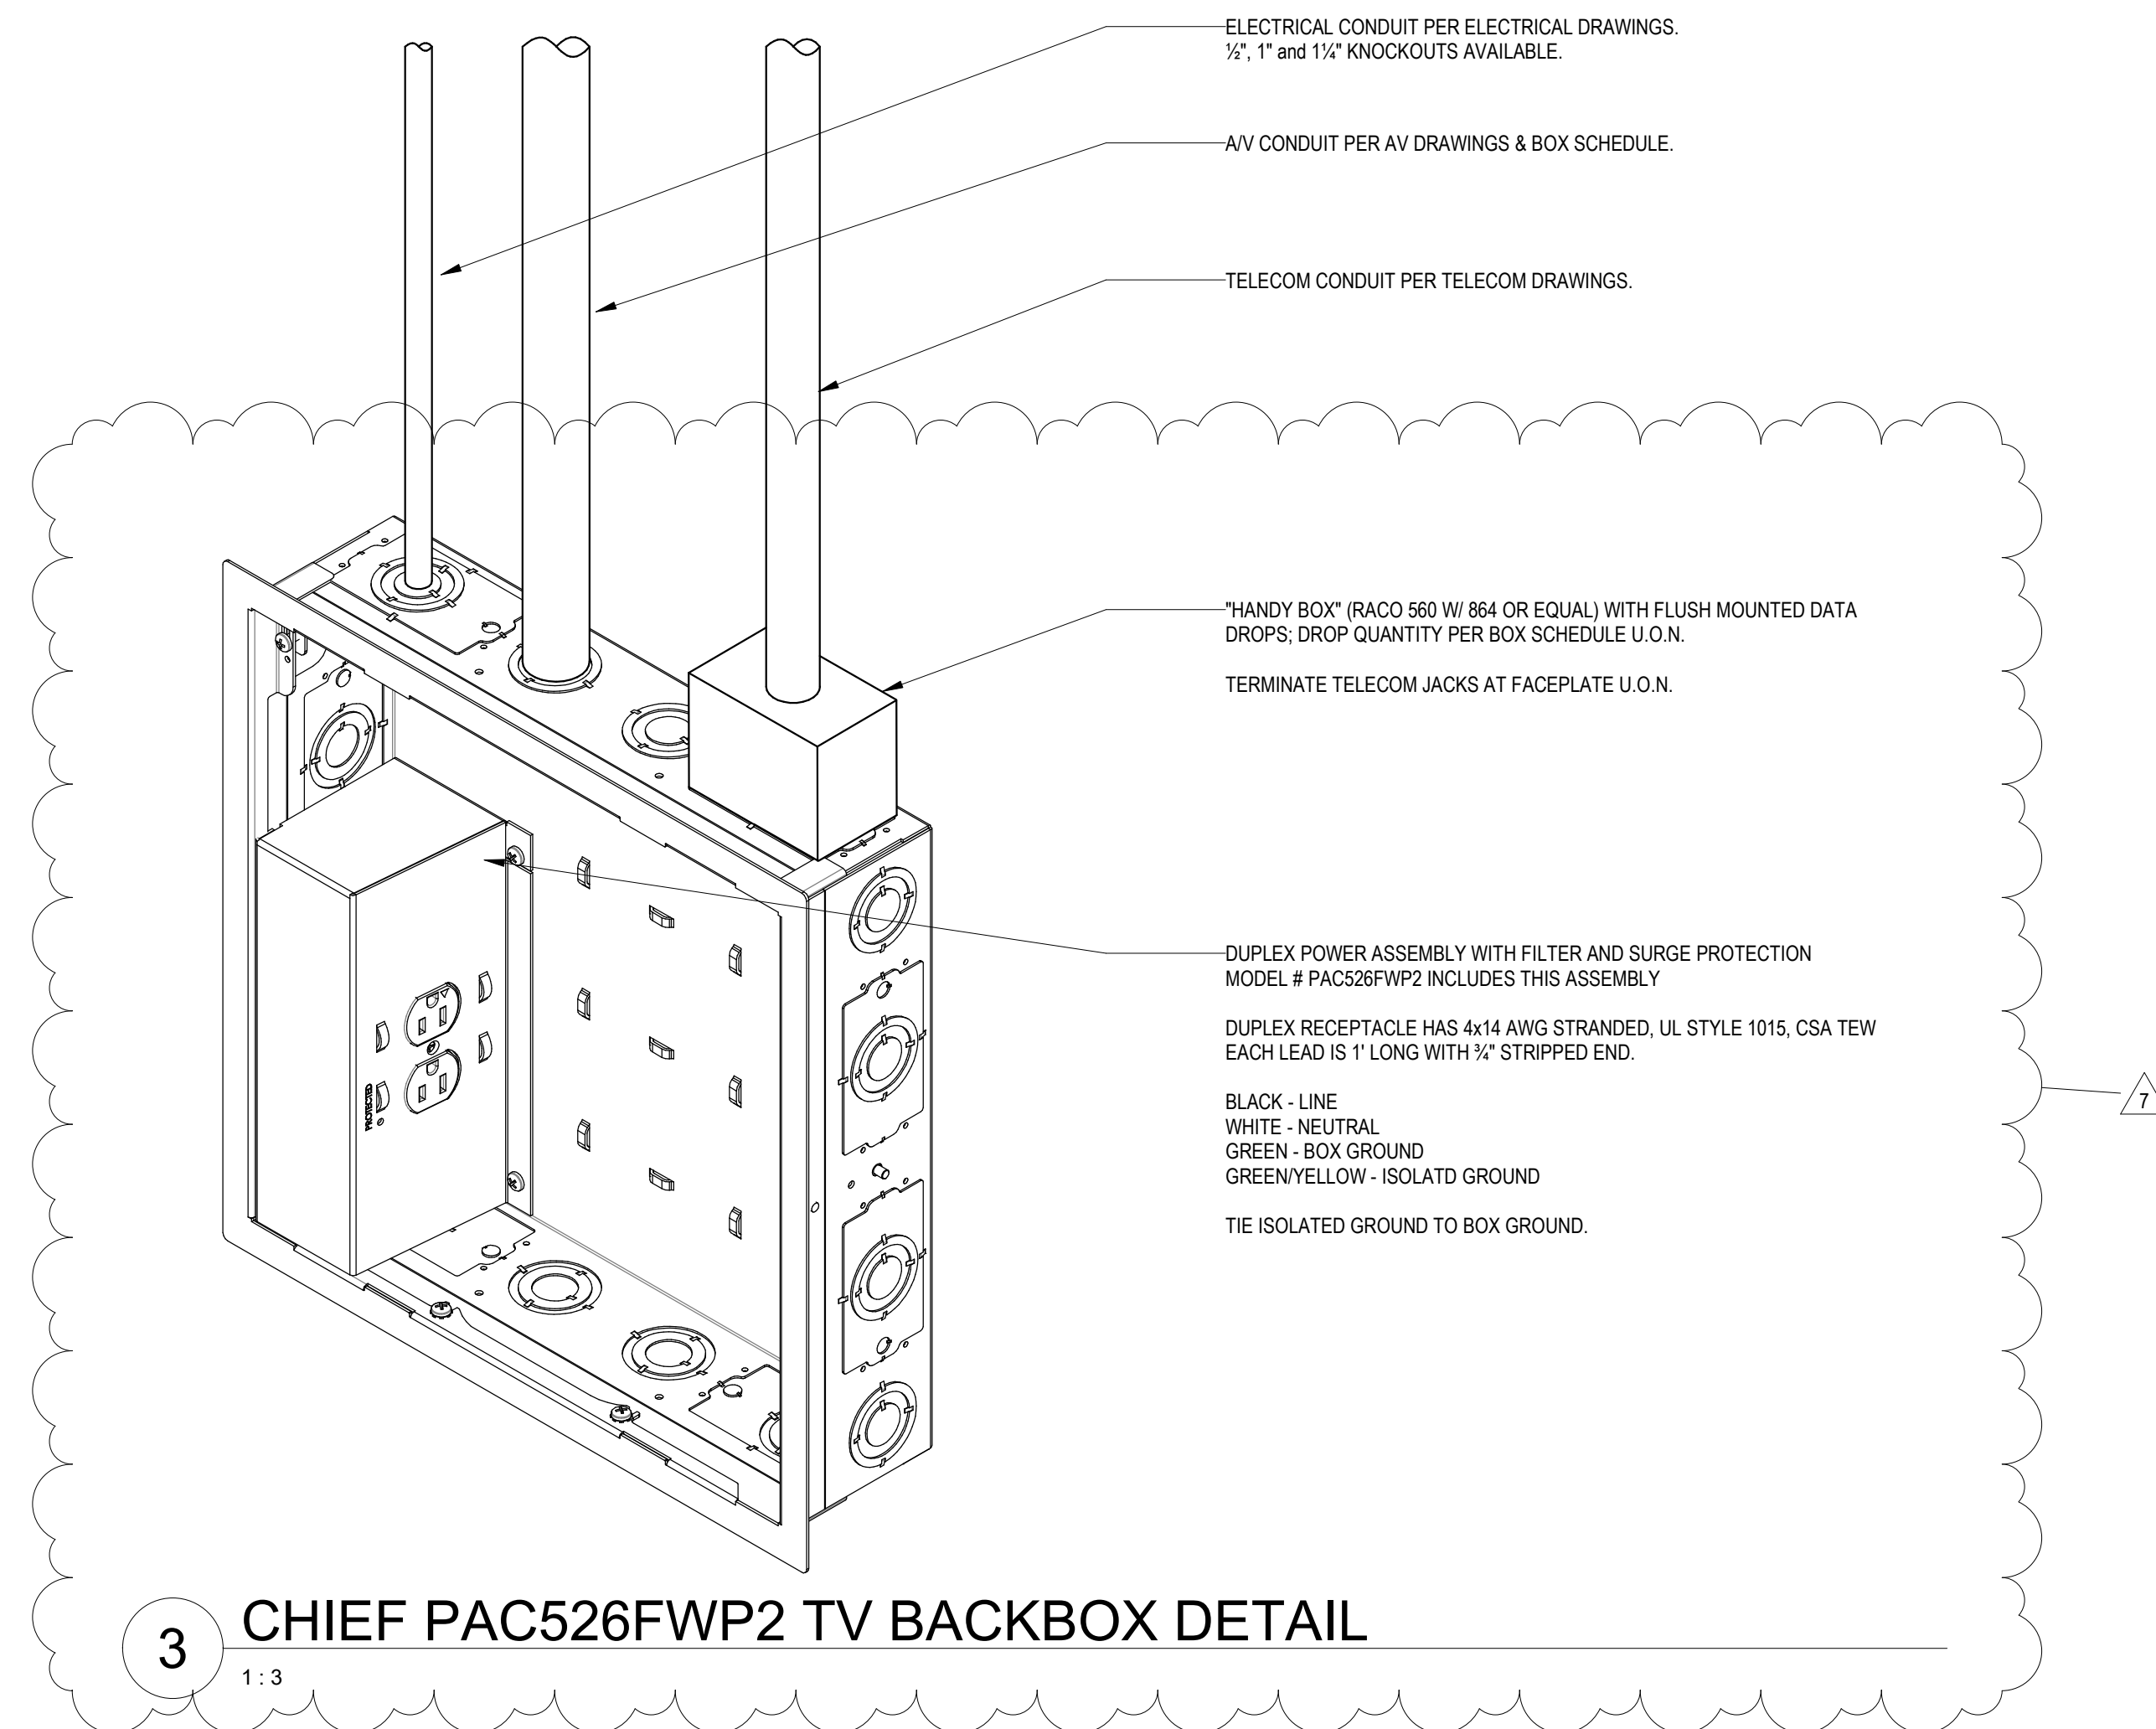

**3 CHIEF PAC526FWP2 TV BACKBOX DETAIL**  
1:3

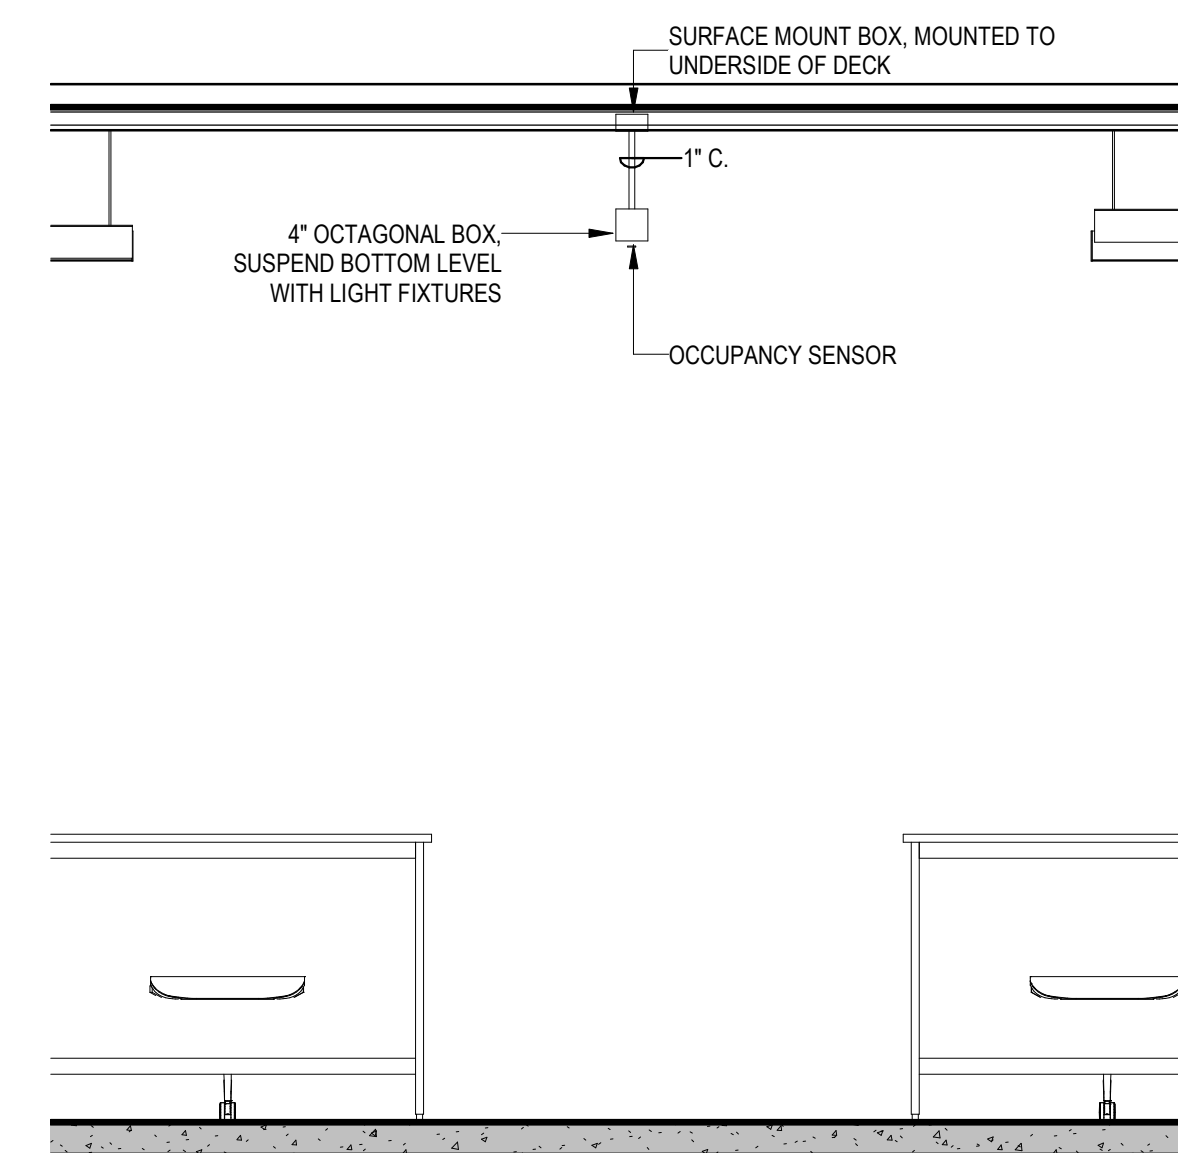

**4 OCC HANGING CONDUIT MOUNT**  
NTS

PROJ. NO. 121091.00  
DRAWN: K2  
CHECKED: EA  
APPROVED: KH  
DATE: 12/22/2022  
REVISIONS:  
7 0123/2023 C08 005

© OZ ARCHITECTURE

ANSCHUTZ ENGINEERING CENTER  
ISSUED FOR:  
100% CD Modifications

SHEET TITLE:  
AUDIOVISUAL DETAILS

SCALE: As Indicated  
SHEET NUMBER

**TA-501**